NOTES

1. DO NOT HEAVILY PRUNE THE TREE AT PLANTING. PRUNE ONLY CROSSING BRANCHES, CO-DOMINANT LEADERS, AND BROKEN OR DEAD BRANCHES. DO NOT PRUNE INTO OLD WOOD ON EVERGREENS.

2. STAKE TREES ONLY UPON THE APPROVAL OF THE LANDSCAPE ARCHITECT. SEE STAKING DETAIL 02930.3. INSTALLATION INCLUDES REMOVAL OF STAKES ONE YEAR AFTER INSTALLATION.

3. MARK THE NORTH SIDE OF THE TREE IN THE NURSERY, AND ROTATE TREE TO FACE NORTH AT THE SITE WHENEVER POSSIBLE.

4. SEE SPECIFICATIONS FOR ADDITIONAL NOTES.

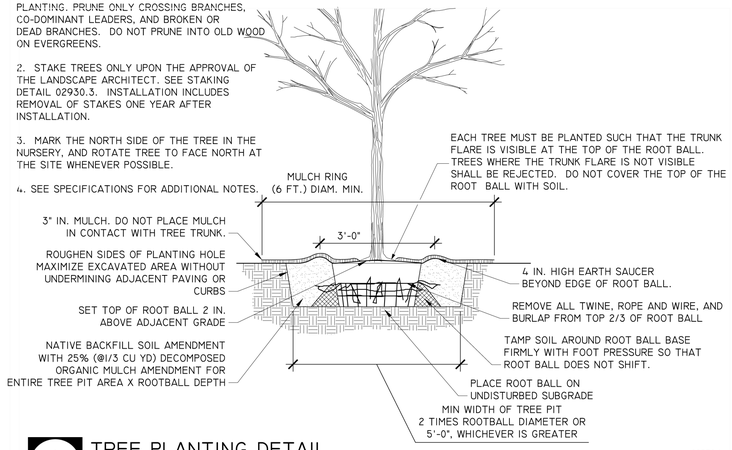

1 LI2.0 **TREE PLANTING DETAIL** 02930.1

FOR OPEN PLANTING AREAS FREE OF PAVING OR GRATES 1/2"=1'-0"

GENERAL NOTES

1. SET PLANTS IN ERECT, STABLE, AND UNIFORM POSITIONS. ORIENT BEST FACE OF PLANT TO BE MOST VISIBLE.

2. DO NOT PLACE MULCH IN CONTACT WITH STEM OF SHRUBS.

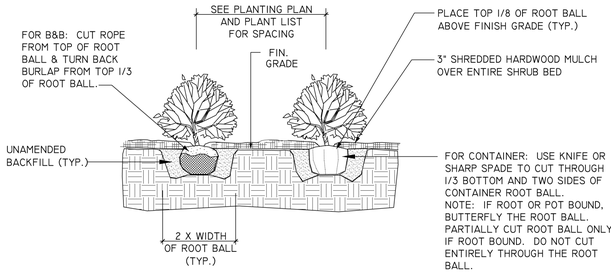

2 LI2.0 **SHRUB PLANTING: CONTAINER AND B&B** 02930.6

SECTION NOT TO SCALE

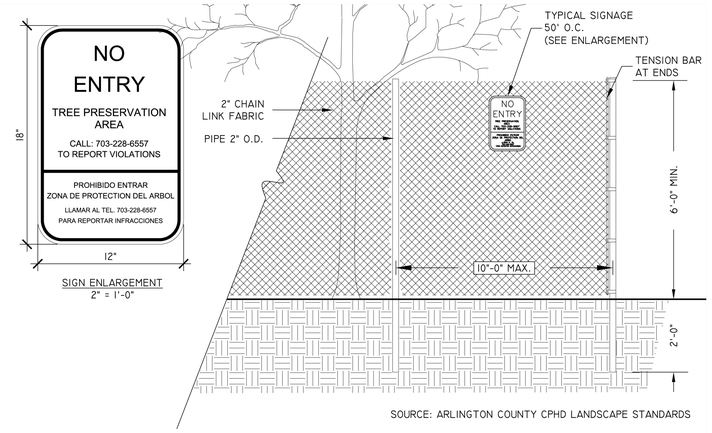

SOURCE: ARLINGTON COUNTY CPHD LANDSCAPE STANDARDS

3 LI2.0 **6' CHAIN LINK TREE PROTECTION FENCE** 02231.1

ELEVATION 1/2" = 1'-0"

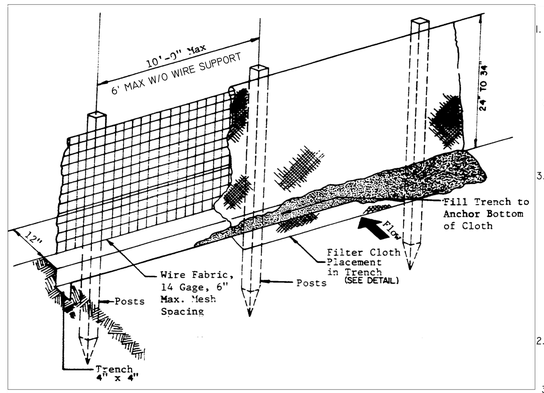

NOTES:

1. WHEN WIRE SUPPORT IS USED, STANDARD STRENGTH FILTER CLOTH MAY BE USED AND POSTS SHALL BE SPACED 10 FEET ON CENTER MAXIMUM.

2. WHEN WIRE SUPPORT IS NOT USED, EXTRA STRENGTH FILTER CLOTH SHALL BE USED AND POSTS SHALL BE SPACED 6 FEET ON CENTER MAXUMUM.

3. SOURCE: ARLINGTON COUNTY DES CONSTRUCTION STANDARDS & SPECIFICATIONS.

MAINTENANCE:

1. SILT FENCE SHALL BE INSPECTED IMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.

2. DECOMPOSED OR INEFFECTIVE SILT FENCE SHALL BE REPLACED PROMPTLY.

3. REMOVE SEDIMENT DEPOSITS AFTER EACH STORM EVENT AND/OR WHEN THEY REACH ONE-HALF OF THE BARRIER HEIGHT.

4 LI2.0 **SILT FENCE** 02370.1

ELEVATION NOT TO SCALE

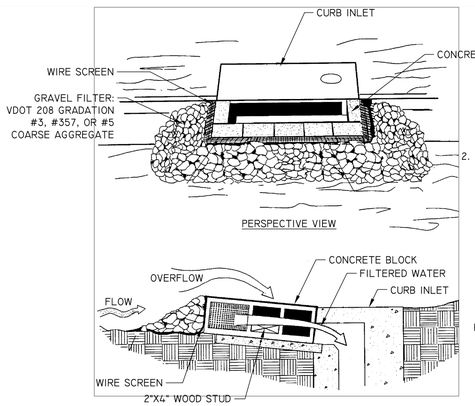

SECTION

MAINTENANCE:

1. THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.

2. SEDIMENT SHALL BE REMOVED AND THE TRAP RESTORED TO ITS ORIGIONAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO ONE HALF THE DESIGN DEPTH. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT WILL NOT ERODE

3. STRUCTURES SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE REMAINING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

SOURCE: VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK

5 LI2.0 **CURB INLET PROTECTION** 02370.4

PERSPECTIVE/SECTION NOT TO SCALE

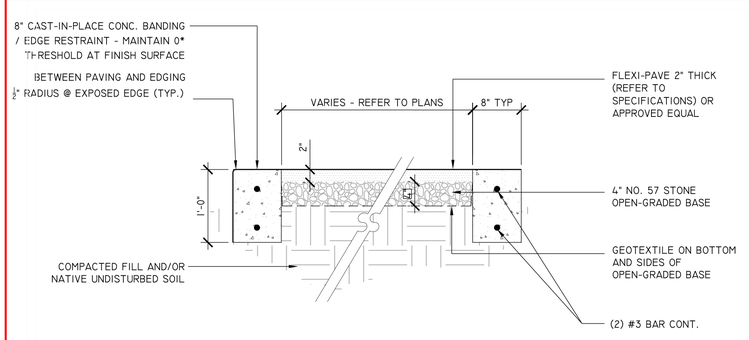

SECTION

NOTE: INTERIOR EDGE OF CONCRETE EDGE RESTRAINT ADJACENT TO PLAY AREAS SHALL HAVE A 1" RADIUS, AS SHOWN ON DETAIL 20, SHEET LI2.2

6 LI2.0 **PERVIOUS PAVEMENT** 1" = 1'-0"

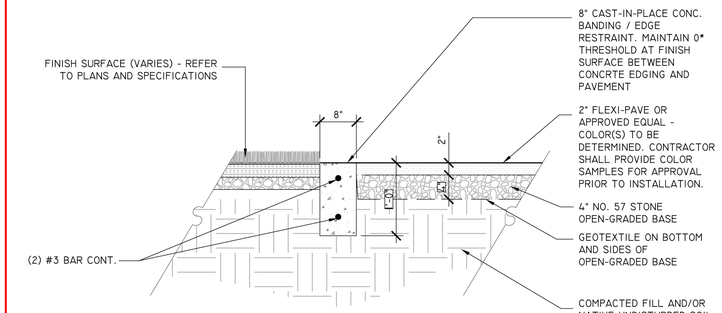

SECTION

7 LI2.0 **CONCRETE CURB / EDGE RESTRAINT** 1" = 1'-0"

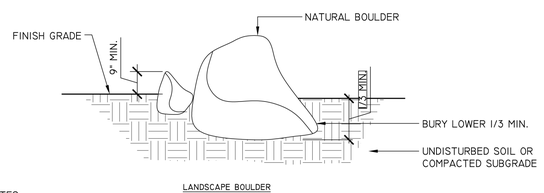

LANDSCAPE BOULDER

NOTES:

1. ALL BOULDERS TO BE A MINIMUM 15 INCHES HIGH WITH MIN. 9 INCHES ABOVE GROUND.

8 LI2.0 **LANDSCAPE BOULDER** 1/2" = 1'-0"

ARLINGTON VIRGINIA

DEPARTMENT OF PARKS AND RECREATION

Park Development Division
2100 Clarendon Boulevard, Suite 414
Arlington, VA 22201
Phone: 703.228.3323
Fax: 703.228.3328

IFB #617-12

Project Name and Location

Ft Myer Heights Playground Reconstruction

1400 N. Fort Myer Drive
Arlington, VA

Sheet Title

Site Details

Approvals	Date
Department Director	2/27/12
Park Development Division Chief	2/21/12
Design Unit Supervisor	2/21/12

Revisions	Date

Designed: AW
Drawn: AW
Checked: BG

Filename: Details.dwg
Plotted: May 03, 2012

Scale: AS_SHOWN
Date: DATE

ARLINGTON COUNTY, VIRGINIA
DEPARTMENT OF ENVIRONMENTAL SERVICES
FT MYER HEIGHTS PLAYGROUND RECONSTRUCTION
SITE DETAILS
ARLINGTON COUNTY PROJECT / BY-RIGHT

SCALE: AS SHOWN	DESIGNED:		CHECKED:
SUBMITTED DATE:	APPROVED DATE: CHIEF TRANSP. PLANNING BUREAU	APPROVED DATE: CHIEF TRANSP. ENGINEERING BUREAU	
APPROVED DATE: CHIEF WATER, SEWER, & STR. BUREAU	APPROVED DATE: CHIEF ENGINEERING BUREAU	APPROVED DATE: DIRECTOR OF ENV. SERVICES	
		SHEET LI2.0	CONTRACT H- SHEET 12 OF 14

FOR INFORMATION ONLY

L:\Division\Park Development\Projects\Fort Myer Heights Park\Playground\Design\CAD\CDs\